




URBAN STANDARD SPECIFICATIONS for PUBLIC IMPROVEMENT MANUAL

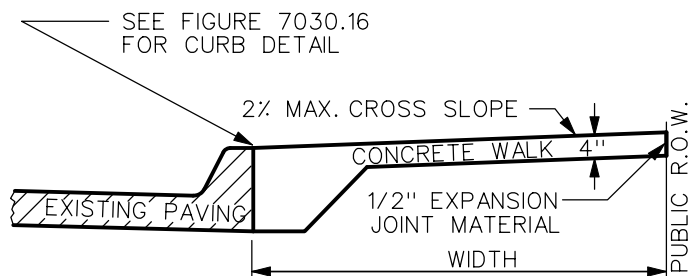


CLASS "A" SIDEWALK
(SIDEWALK EXTENDS FROM BACK OF CURB TO PUBLIC R.O.W.)

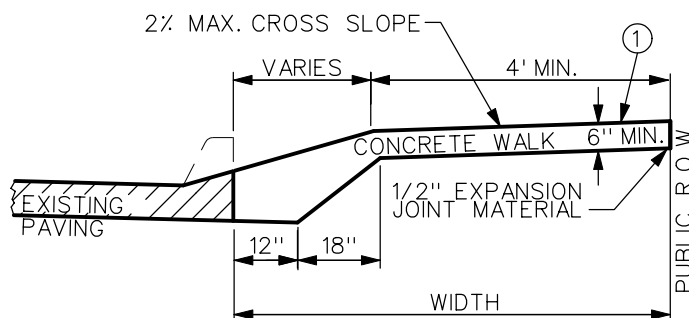


CLASS "A" SIDEWALK AT DRIVEWAY

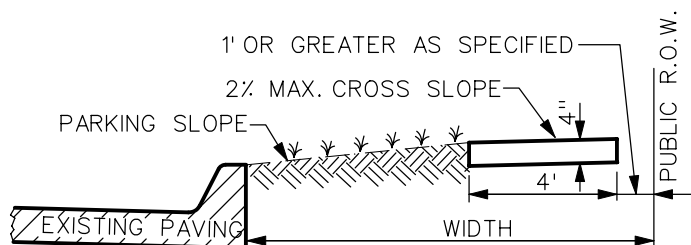


CLASS "B" SIDEWALK

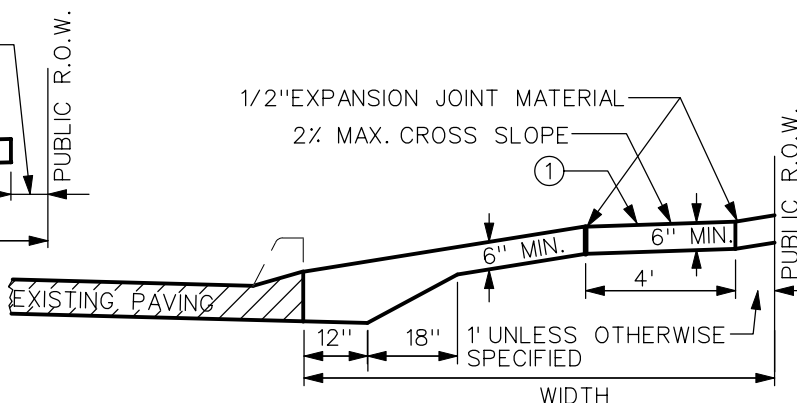

CLASS "B" SIDEWALK AT DRIVEWAY
(BACK OF SIDEWALK IS LOCATED 1' MIN. FROM PUBLIC R.O.W.)

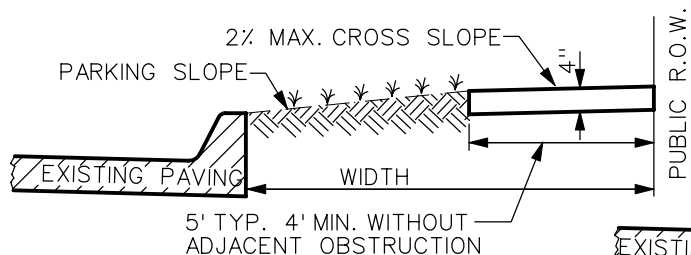

CLASS "C" SIDEWALK
(BACK OF SIDEWALK IS LOCATED ON PUBLIC R.O.W.)

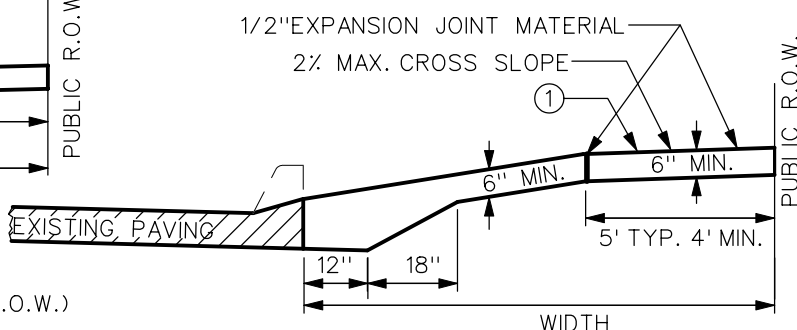

CLASS "C" SIDEWALK AT DRIVEWAY

PARKING SLOPES: CLASS B & C SIDEWALKS

LESS THAN 10 FEET WIDE: 1/4" PER FOOT (2% MIN.) (TYPICAL)

OVER 10 FEET WIDE: 1/2" PER FOOT (4%) (TYPICAL)

NOTE: SPECIAL GRADES MAY BE SPECIFIED FOR SOME STREETS

DRIVEWAY SLOPES:

MAXIMUM DRIVEWAY SLOPE (FROM GUTTER TO FRONT OF SIDEWALK) SHALL BE 10% FOR RESIDENTIAL DRIVEWAYS AND 7% FOR COMMERCIAL DRIVEWAYS. DRIVEWAY GRADES GREATER THAN THESE REQUIRE APPROVAL OF THE JURISDICTION.

- ① SIDEWALK THICKNESS AT DRIVEWAY SHALL BE 6" MIN. OR THE THICKNESS OF THE DRIVEWAY, WHICHEVER IS GREATER.

3	10/21/03		CLASSES OF SIDEWALKS AND RECREATIONAL TRAILS	FIGURE: 7030.8
REV.	DATE	BY		SHEET 1 OF 1
DATE: 01-01-98				